NEW WORK NOTES THIS SHEET

1. PROVIDE HWS/HWR PIPING, INSULATION, HANGERS, AND SUPPORTS COMPLETE.
2. RELOCATE STORED THERMOSTAT. PROVIDE ADDITIONAL CONTROL WIRING AS REQUIRED.
3. SEE SHUT-OFF BOX DETAILS FOR PIPING CONNECTION.
4. BALANCE TO GPM INDICATED ON VAV SCHEDULE.
5. PROVIDE WALL MOUNTED THERMOSTAT AND CONTROL WIRING COMPLETE. MOUNT APPROX. 48" AFF.
6. PROVIDE DDC TEMPERATURE SENSOR AND CONTROL WIRING COMPLETE. MOUNT AT 48" AFF.

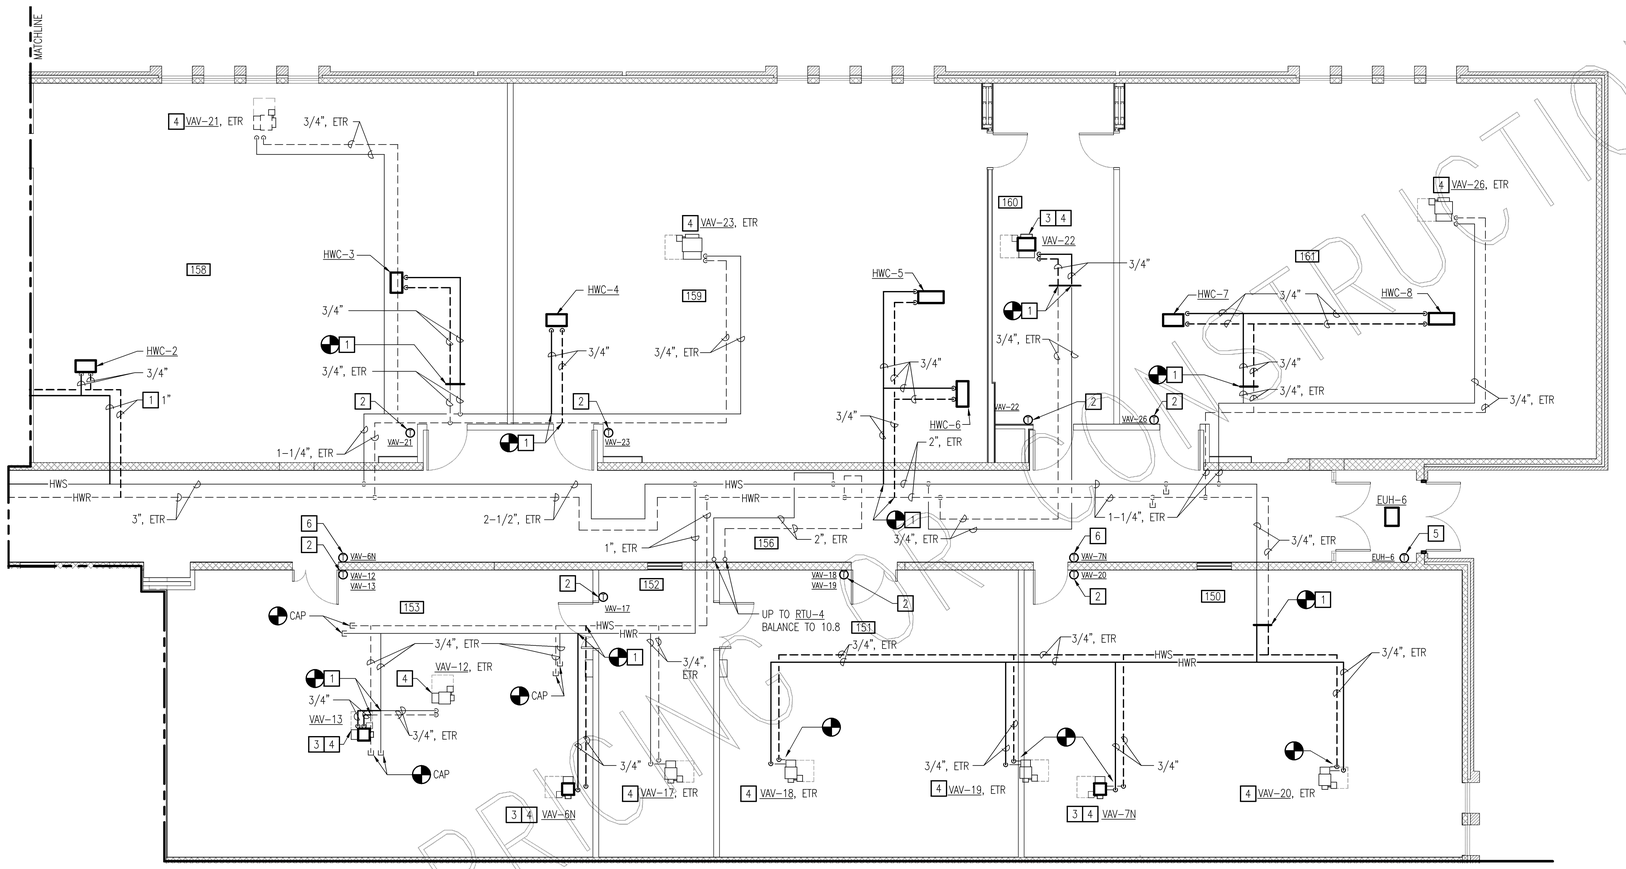

NEW WORK FLOOR PLAN - MECHANICAL PIPING

SCALE: 3/16" = 1'-0"

SECTION 5 ROOM SCHEDULE

150	GENERAL CLASSROOM
151	NURSING LAB
152	NURSING STORAGE
153	NURSING CLASSROOM/LAB
156	CORRIDOR
158	CHEM/PHYSICS LAB
159	BIOLOGY LAB 1
160	BIOLOGY PREP
161	BIOLOGY LAB 2



KEYPLAN
NO SCALE

GRAPHIC SCALES

3/16" = 1'-0" 0' 5' 10' 20'

NOT FOR CONSTRUCTION
NOT FOR PRICING

nbj ARCHITECTURE
A Professional Limited Company
GROVE PARK SQUARE
11537-B NUCKOLS ROAD
Richmond, Virginia 23059
(804) 273-9811 fax: (804) 273-9843

RAPPAHANNOCK COMMUNITY COLLEGE
CAMPUS RENOVATIONS
WARSAW + GLENNS, VIRGINIA
PC: 260-17712

WARSAW CAMPUS
NEW WORK FLOOR PLAN - MECHANICAL PIPING

Date: JANUARY 13, 2010

REVISIONS

NO.	DATE

PACE COLLABORATIVE
MECHANICAL ELECTRICAL ENGINEERS
VIRGINIA BEACH, VA - 757-486-7229

COMMONWEALTH OF VIRGINIA
JOHN M. NEWELL
Lic. No. 035329
01.13.10
PROFESSIONAL ENGINEER

Sheet
M2.5W

File Number
XX